

Test Report No.: A-2024-374-01



Kiwa GmbH

Soundlab Aachen  
Hauptstraße 133  
D-52477 Alsdorf

T: +49 (0) 2404 59 696 40  
E: DE.Soundlab@kiwa.com

Kiwa GmbH, Soundlab Aachen, Hauptstraße 133, D-52477 Alsdorf

Unifloor B.V.  
Arnsbergstraat 4  
7418 Deventer  
The Netherlands

[www.kiwa.de](http://www.kiwa.de)



The accreditation is valid for the test procedures listed in the annex of the certificate D-PL-11217-01-00.

Test Order: Laboratory measurement of the reduction of transmitted impact sound by floor coverings on a reference floor according to DIN EN ISO 10140-1,3:2021-09

Order date: 26.11.2024

Sample description: acoustic underlay

a) Jumpax Classic 10mm

Number of samples: N/A

Sampling: by client

Sample receipt: 26.11.2024

Test period: 26.11.2024

Aachen, 17.12.2024

A handwritten signature in black ink, appearing to read "A. Siebel".

i.V. Prof. Dr.-Ing. Alexander Siebel  
Laboratory Manager

A handwritten signature in black ink, appearing to read "P. Thomas M. Eng".

i.V. Patrick Thomas M. Eng  
Deputy Laboratory Manager

The test results relate only on the items tested. Without the written approval of the testing laboratory, a duplication in extracts of the test report is not permitted.

a) Information provided by the client, k) Modification

## 1 Product Description

### Product Description a) (Construction from top to bottom)

Position	Description	Thickness [mm]	Weight [g/m <sup>2</sup> ]
1	Marmoleum 2mm	2,0	2300
2	Jumpax Classic 10mm	10,0	5500
3	PE Foil	-	160



Illustration / drawing for sample assembly

## 2 Scope of testing / Annexes

No	Annex	Designation	Standard	Pages general	Pages evaluation
1	TS	Impact Sound Reduction	DIN EN ISO 10140-1,3:2021-09	2	1

QMF P A 101 a\_R.8\_07.03.2024

a) Information provided by the client, k) Modification



# General Annex TS for laboratory impact sound tests

## 1 Test stand description

Test rooms:	Laboratory of Kiwa GmbH, Hauptstraße 133, 52477 Alsdorf
Sending room:	4,27 m x 4,45 m x 2,74 m; V = 52,1 m <sup>3</sup> (cubic, with diffusers)
Receiving room:	3,95 m x 4,08 m x 3,33 m; V = 53,6 m <sup>3</sup> (cubic, with diffusers)
Test floor:	4,27 m x 4,45 m; S = 19 m <sup>2</sup> 14 cm homogeneous heavyweight concrete slab floor with an area-related mass of m' ≈ 322 kg/m <sup>2</sup> (no ceiling below)
Flanking walls:	lime sand brick walls with light weighting facing shells (d = 12cm) with a medium area-related mass of m' ≈ 330 kg/m <sup>2</sup>

## 2 Analysis

The impact sound levels generated by the standardized tapping machine are measured in the receiving room below a solid floor without and with the floor covering. From the measured values the reduction of impact sound pressure is calculated as follows:

$$\Delta L = L_{n,0} - L_n \text{ in dB}$$

$$L_{n,0} = \text{Impact sound level without floor covering in dB}$$

$$L_n = \text{Impact sound level with floor covering in dB}$$

To determine the weighted impact sound reduction the applicable reference curve is shifted in 1 dB steps into the measured curve so that the sum of the most unfavorable deviations corresponds as close as possible to the value of 32 dB without exceeding this value.

The linear impact sound level  $\Delta L_{lin}$  you can calculate after the following equation:

$$\Delta L_{lin} = L_{n,r,0,w} + C_{I,r,0} - (L_{n,r,w} + C_{I,r}) = \Delta L_w + C_{I,\Delta}$$

$L_{n,r,w}$  the calculated weighted norm impact sound level of the cover blanket with the blanket edition to be checked is.

$L_{n,r,0,w}$  78 dB, investigates  $L_{n,r,0}$  to 4.3.1 DIN EN ISO 717-2:2021-05.

$C_{I,r}$  Spectrum customization value.

$C_{I,r,0}$  Spectrum customization value.

## 2.1 Test Standards

Standard: (Issue)	Title
DIN EN ISO 10140-1:2021-09	Acoustics — Laboratory measurement of sound insulation of building elements — Part 1: Application rules for specific products
DIN EN ISO 10140-2:2021-09	Acoustics — Laboratory measurement of sound insulation of building elements — Part 2: Measurement of airborne sound insulation
DIN EN ISO 10140-3:2021-09	Acoustics — Laboratory measurement of sound insulation of building elements — Part 3: Measurement of impact sound insulation
DIN EN ISO 10140-4:2021-09	Acoustics — Laboratory measurement of sound insulation of building elements — Part 4: Measurement procedures and requirements
DIN EN ISO 10140-5:2021-09	Acoustics — Laboratory measurement of sound insulation of building elements — Part 5: Requirements for test facilities and equipment

## 2.2 Evaluation Standards

Standard: (Issue)	Title
DIN EN ISO 717-2:2021-05	Acoustics — Rating of sound insulation in buildings and of building elements — Part 2: Impact sound insulation
DIN EN ISO 12999-1:2021-04	Acoustics — Determination and application of measurement uncertainties in building acoustics — Part 1: Sound insulation
ASTM E989 – 18	Standard Classification for Determination of Single-Number Metrics for Impact Noise
ASTM E2179 - 03(2016)	Standard Test Method for Laboratory Measurement of the Effectiveness of Floor Coverings in Reducing Impact Sound Transmission Through Concrete Floors

## 3 Note

The results are based on measurements performed under laboratory conditions with artificial excitation (standard procedure). The test results are applicable in due consideration of the national provisions and the local circumstances and/or constructions.

**Reduction of impact sound pressure level according to DIN EN ISO 10140-1,2,3,4,5:2021-09**

Annex TS -  $\Delta L_w$

Laboratory measurement of the reduction of transmitted impact sound by floor coverings on a reference floor

Evaluation according DIN EN ISO 717-2:2021-05

Measurement uncertainty according DIN EN ISO 12999-1:2021-04

Date of test: 26.11.2024

Construction: Marmoleum 2mm  
(from top to bottom) Jumpax Classic 10mm  
PE Foil

Test floor: 14 cm concrete slab floor (4,27 m x 4,45 m) with an area-related mass  $m' \approx 322 \text{ kg/m}^2$  (no ceiling)

Remarks: -

Installation: by the client

Receiving room:

Volume: 53,6 m<sup>3</sup>

Sending room:

Volume: 52,1 m<sup>3</sup>

Air temperature: 19,7 °C

Relative air humidity: 50,6 %

Boundary conditions:

Tapping Machine positions: 4


Microphone positions: 8

Category / sample area: II / 10 m<sup>2</sup>

Type of reference floor: heavyweight reference floor

----- Frequency range for rating according to DIN EN ISO 717-2:2021-05

Frequency f [Hz]	$L_{n,0}$ 1/3 oct. [dB]	$\Delta L$		U 1/3 oct. [dB]
		1/3 oct. [dB]	1/3 oct. [dB]	
50	56,4	4,2 <sup>3</sup>	± 1,4	
63	54,5	1,8	± 1,3	
80	52,0	1,7	± 1,2	
100	57,9	1,6	± 1,1	
125	68,6	1,8	± 1,0	
160	63,6	2,8	± 1,0	
200	63,9	3,8	± 1,0	
250	63,7	5,8	± 1,0	
315	64,8	8,3	± 1,0	
400	63,7	14,3	± 1,1	
500	63,9	19,7	± 1,2	
630	65,7	22,1	± 1,3	
800	65,7	29,6	± 1,6	
1000	67,1	35,6	± 1,9	
1250	67,7	43,2	± 2,2	
1600	67,3	48,4	± 2,5	
2000	68,1	52,5 <sup>3</sup>	± 2,8	
2500	67,9	55,3 <sup>3</sup>	± 3,2	
3150	68,5	60,9 <sup>3</sup>	± 3,6	
4000	67,9	63,2 <sup>1</sup>	± 4,0	
5000	64,2	61,4 <sup>1</sup>	± 4,4	

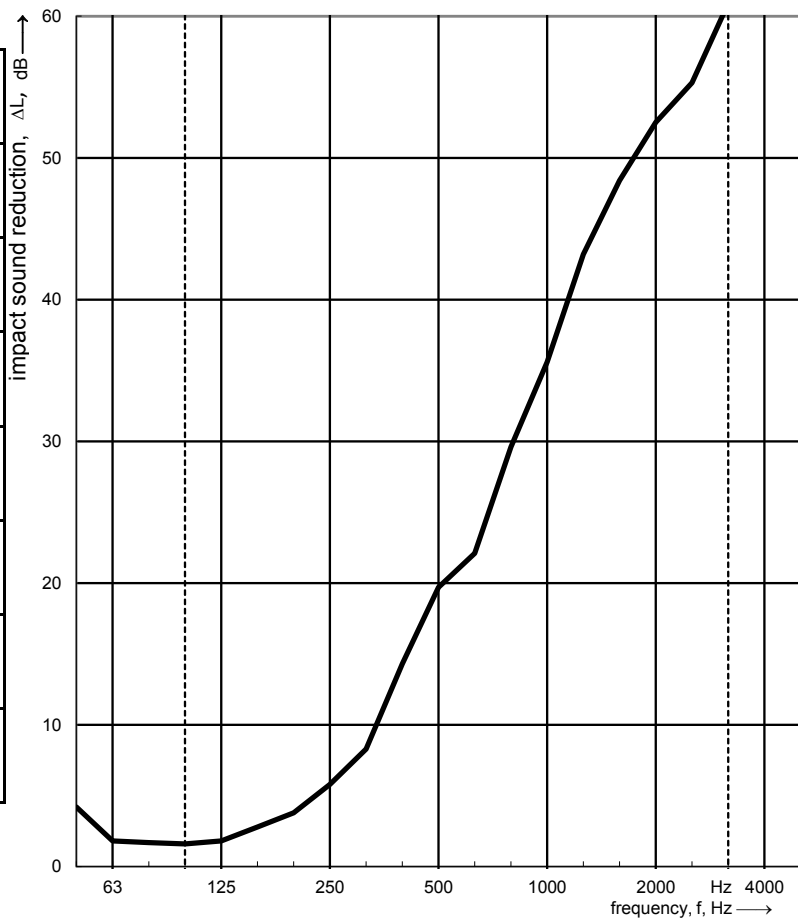

<sup>1</sup> Measurement limit reached

<sup>3</sup> correction

Evaluation according DIN EN ISO 717-2:2021-05

$\Delta L_w = 21 \text{ dB}$   $C_{1,\Delta} = -11 \text{ dB}$

$\Delta L_{lin} = 10 \text{ dB}$   $C_{1,r} = 0 \text{ dB}$

Measurement uncertainty according DIN EN ISO 12999-1:2021-04

$\Delta L_w = ( 20,7 \pm 1,1 ) \text{ dB}$  ( $k = 1$ , two-sided)

These results are based on a test performed with an artificial source under laboratory conditions (engineering method) with the specified reference floor.

Test report no.: A-2024-374-01

