

TFI Report 461274-09

Impact Sound Insulation

Customer
Unifloor BV
Munsterstraat 24
7418 EV Deventer
NETHERLANDS

Product
floor underlay
Jumpax Classic

This report includes 2 pages and 1 annex(es)
This report is a correction of 461274-01.

Responsible at TFI

Dr.-Ing. Heike Kempf
Tel: +49 241 9679 171
h.kempf@tfi-online.de

Aachen, 08.11.2016

Dr. Alexander Siebel

- Deputy head of the testing laboratory -

The present document is provided with an advanced electronic signature



This report only applies to the tested samples and has been established to the best of our knowledge. Only the entire report shall be reproduced. Under no circumstances, extracts shall be used. Furthermore, we apply the "General Terms and Conditions for the Execution of Contracts" of the TFI Aachen GmbH, also with regard to the order execution.

1 Transaction

Test order	Sound insulation according to EN ISO 10140:2010
Order date	15.07.2016
Your reference	F. Vousten
Product designation	PVC Click 5 mm, Jumpax Classic
TFI sample number	16-07-0136, 16-07-0138


2 Product Specification / Construction

Description	Underlayer
Material	MDF*
Thickness	10 mm*


Thickness: Material:

5 mm*	PVC Click (16-07-0136)
10 mm*	Jumpax Classic (16-07-0138)

* customer information

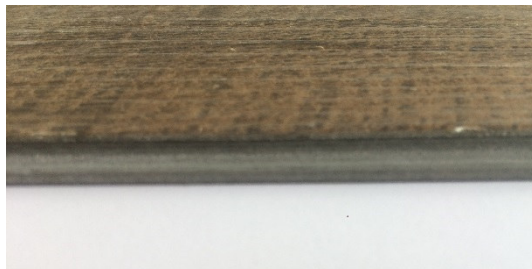

PVC Click (16-07-0136)

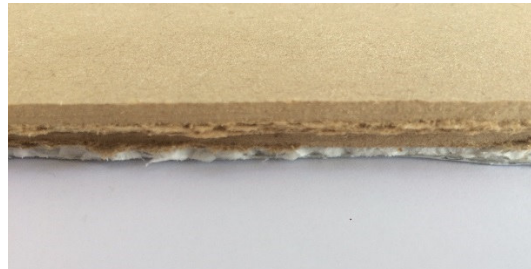

Jumpax Classic (16-07-0138)

3 Results

Impact sound insulation [ΔL_w]	21 dB	($\Delta L_{lin} = 10$ dB)
--	-------	-----------------------------

4 Annexes

Impact sound insulation	TS 461274-09
-------------------------	--------------

The annexes marked ^a are based on tests accredited in accordance with EN ISO/IEC 17025.

Annex TS - Impact Sound Insulation

1 Transaction

Product designation	PVC Click 5 mm, Jumpax Classic
TFI sample number	16-07-0136, 16-07-0138
Testing period	15.07.2016

2 Test Method / Requirements

EN ISO 10140-1:2014	Acoustics - Laboratory measurement of sound insulation of building elements - Part 1: Application rules for certain products
EN ISO 10140-2:2010	Acoustics - Laboratory measurement of sound insulation of building elements - Part 2: Measurement of airborne sound insulation
EN ISO 10140-3:2015	Acoustics - Laboratory measurement of sound insulation of building elements - Part 3: Measurement of impact sound reduction
EN ISO 10140-4:2010	Acoustics - Laboratory measurement of sound insulation of building elements - Part 4: Measurement procedures and requirements
EN ISO 10140-5:2014	Acoustics - Laboratory measurement of sound insulation of building elements - Part 5: Requirements for test facilities and equipment
EN ISO 717-1:2013	Acoustics - Rating of sound insulation in buildings and of building elements - Part 1: Airborne sound insulation
EN ISO 717-2:2013	Acoustics - Rating of sound insulation in buildings and of building elements - Part 2: Impact sound reduction

3 Remarks

None

4 Measuring Operation

Measurement of the impact sound pressure level:	Using with 8 tapping machine position. (The single results of the one-third-octave-bands were averaged on an energy basis)
Test surface:	~11m ²
Category:	II
Connection with the floor:	loose laid
Damage to the sample:	None

5 Laboratories

Test rooms:	Laboratories of the TFI Aachen GmbH, Hauptstrasse133, 52477 Alsdorf, Germany
Sending room (1.04):	V = 52.4 m ³ (with diffusers)
Receiving room (0.01):	4.05 m x 3.95 m x 3.33 m + 2.00 m x 0.98 m x 0.18 m; V = 53.6 m ³ (cuboid room, with diffusers)
Reference floor:	4.27 m x 4.46 m; S = 19.04 m ² 14 cm concrete slab floor with an area-related mass of m' ~ 322 kg/m ²
Flanking walls:	Lime sand brick walls with light wall facings (facing shell d= 12cm) with an average area-related mass of m' ~ 330 kg/m ²

Weighted normalized impact sound pressure level	$L_{n,0,w}$	=	73	dB
Weighted normalized impact sound pressure level	$L_{n,w}$	=	52	dB
Weighted normalized impact sound pressure level	$L_{n,r,w}$	=	57	dB

6 Measuring Devices

Real time analyser:	CESVA INSTRUMENTS, TYP: SC310, SN: T237102
Microphone:	CESVA INSTRUMENTS, TYP: C130, SN: 13523
Microphone amplifier:	CESVA INSTRUMENTS, TYP: PA13, SN: 4162
Calibrator:	CESVA INSTRUMENTS, TYP: CB006, SN 49649
Tapping machine:	NORSONIC, Type 211, SN: 502 (standard tapping machine with 3 feet and 5 hammers according to ISO 10140)

7 Evaluation

The impact sound pressure level generated by the standard tapping machine is measured in the receiving room under a bare heavy floor with and without a floor covering. The impact sound reduction is determined on the basis of the measured values as follows:

$$\Delta L = L_{n,0} - L_n \text{ (dB)}$$

$L_{n,0}$ Impact sound pressure level without a floor covering (dB)

L_n Impact sound pressure level with a floor covering (dB)

For the evaluation of the weighted reduction in impact sound pressure level ΔL_w , the relevant reference curve is shifted in increments of 1 dB towards the measured curve until the sum of unfavourable deviations is as large as

possible, but not more than 32 dB.

The linear impact sound level ΔL_{lin} is determined according to the following equation:

$$\Delta L_{lin} = L_{n,r,0,w} + C_{l,r,0} - (L_{n,r,w} + C_{l,r}) = \Delta L_w + C_{l,\Delta}$$

$L_{n,r,w}$	is the calculated weighted normalized impact sound pressure level of the reference floor with the floor covering under test
$L_{n,r,0,w}$	78 dB, calculated from $L_{n,r,0}$ according to Section 4.3.1 of DIN EN ISO 717-2: 2013
$C_{l,r}$	Spectrum adaptation term for the reference floor with the floor covering to be tested
$C_{l,r,0}$	-11 dB, spectrum adaptation term for the reference floor with $L_{n,r,0}$ determined according to Annex A, Section A.2.1 of DIN EN ISO 717-2:2013

8 Note

The results are based on measurements performed under laboratory conditions with artificial excitation (standard procedure). The test results are applicable in due consideration of the national provisions and the local circumstances and/or constructions.

Impact sound insulation according ISO 10140-1

Laboratory measurements of the reduction of transmitted impact noise by floor coverings on a heavyweight reference floor

Product name PVC Click 5 mm, Jumpax Classic Testing period 15.07.2016

TFI sample number 16-07-0136, 16-07-0138

Construction PVC Click 5 mm
(from top to bottom) Jumpax Classic

Installed by costumer


Receiving room

Volume 53,6 m³
Air temperature 18,9 °C
Relative air humidity 67,8 %
Static pressure 100,8 kPa

Source room

Volume 52,4 m³
Air temperature 19,2 °C
Relative air humidity 63,4 %
Type of reference floor: Massiv

Frequency f [Hz]	L _{n,0} 1/3 oct. [dB]	ΔL 1/3 oct. [dB]
50	61,3	3,6
63	63,8	-0,2
80	61,0	1,6
100	57,2	2,4
125	65,6	3,9
160	62,4	3,5
200	63,6	4,2
250	66,9	6,6
315	63,7	5,6
400	64,2	9,6
500	63,4	15,3
630	64,8	23,2
800	66,1	31,0
1000	65,3	34,9
1250	66,5	40,1
1600	67,6	43,6
2000	67,3	48,2
2500	67,3	54,5
3150	67,7	58,6 ¹
4000	66,6	58,6 ¹
5000	63,8	57,3 ¹

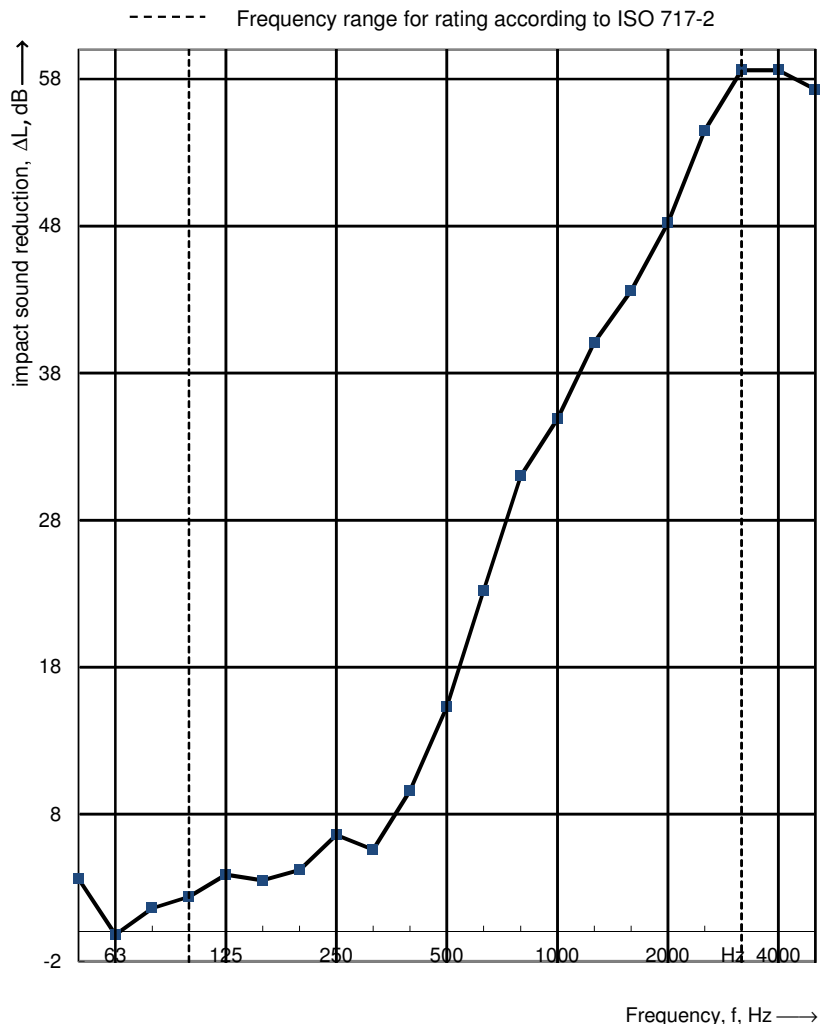¹ correction basic noise

Rating according to ISO 717-2

 $\Delta L_w = 21$ dB $\Delta L_{Lin} = 10$ dB $C_{L,\Delta} = -11$ dB $C_{L,r} = 0$ dB

The results are based on a test performed with an artificial source under laboratory conditions (engineering method) with the specified reference floor.