

Short test report

Measurement of impact sound insulation

Test report No.: 143/162

Applicant unifloor B.V.
Munsterstraat 24
NL 7418 EV Deventer

Schallschutzprüfstelle VPMA · Zertifiziert
Güteprüfungen · Eignungsprüfungen · ABP
Staatlich anerkannte Sachverständige für den
Schallschutz und Wärmeschutz · IK-Bau NRW
Blower Door Messungen · Gebäudethermografie ·
Energieberatung · EnEV-Nachweise Wohn-
gebäude · EnEV-Nachweise Nicht-Wohngebäude

Geschäftsführer:
Dr.-Ing. Lothar Siebel
Dipl.-Ing. Bernd Gebing

Steuer-Nr. 201/5992/3795
USt.-IdNr. DE123595587

Tel. +49(0)241/970220
Fax +49(0)241/572956
info@SWAGmbH.de
www.SWAGmbH.de

Aachen, 26.05.2014

Product Name Underlay System
Jumpax HD

Construction 10 mm Jumpax HD
(from top to bottom) 2,5 mm Amtico Spacia

Category II according to ISO 10140, see annotation
Testing surface 10 m²
Installation loose laid on the floor
Annotations weighted down with ca. 23 kg/m²

Supplement 1 cf. s measurement results

$\Delta L_w = 22$ dB

$\Delta L_{in} = 12$ dB

$C_{i,\Delta} = -10$ dB

$C_{i,r} = -1$ dB

$C_{i,r,50-2500} = 3$ dB

Fundamentals: EN ISO 10140-1 : 2010-12
EN ISO 10140-3 : 2010-12
EN ISO 10140-4 : 2010-12
EN ISO 10140-5 : 2010-12
EN ISO 717-2 : 2013-06

(Dr.-Ing. A. Siebel)

Number of pages:

1 pages and 1 supplement

Measurement of impact sound insulation according to ISO 10140-3 : 2010-12

Laboratory measurement of sound insulation of building elements.


Product name: Jumpax HD
 Category: II according to ISO 10140, see annotation
 Konstruktion: 10 mm Jumpax HD -
 (from top to bottom) 2,5 mm Amtico Spacia -

Reference floor: solid concrete floor
 installed by: applicant

Date of test: 31.03.2014
 annotations: weighted down with ca. 23 kg/m², loose laid on the floor

climate in the source room in the receiving room
 air temperature: 19°C 19 °C
 humidity: 54% 57%

Frequency f [Hz]	L _{n,0} third-octave [dB]	ΔL third-octave [dB]
50	56,5	4,1
63	62,7	-1,6
80	57,4	3,5
100	57,2	3,8
125	67,5	6,6
160	62,6	6,5
200	64,1	5,7
250	67,1	6,3
315	65,3	8,9
400	64,7	11,0
500	65	14,3
630	65,3	23,1
800	66,4	29,4
1000	67,8	34,9
1250	67,7	38,3
1600	68,2	42,3
2000	68,8	46,4
2500	68,6	52,5
3150	67,9	55,3
4000	66,9	56,3
5000	64,4	54,9

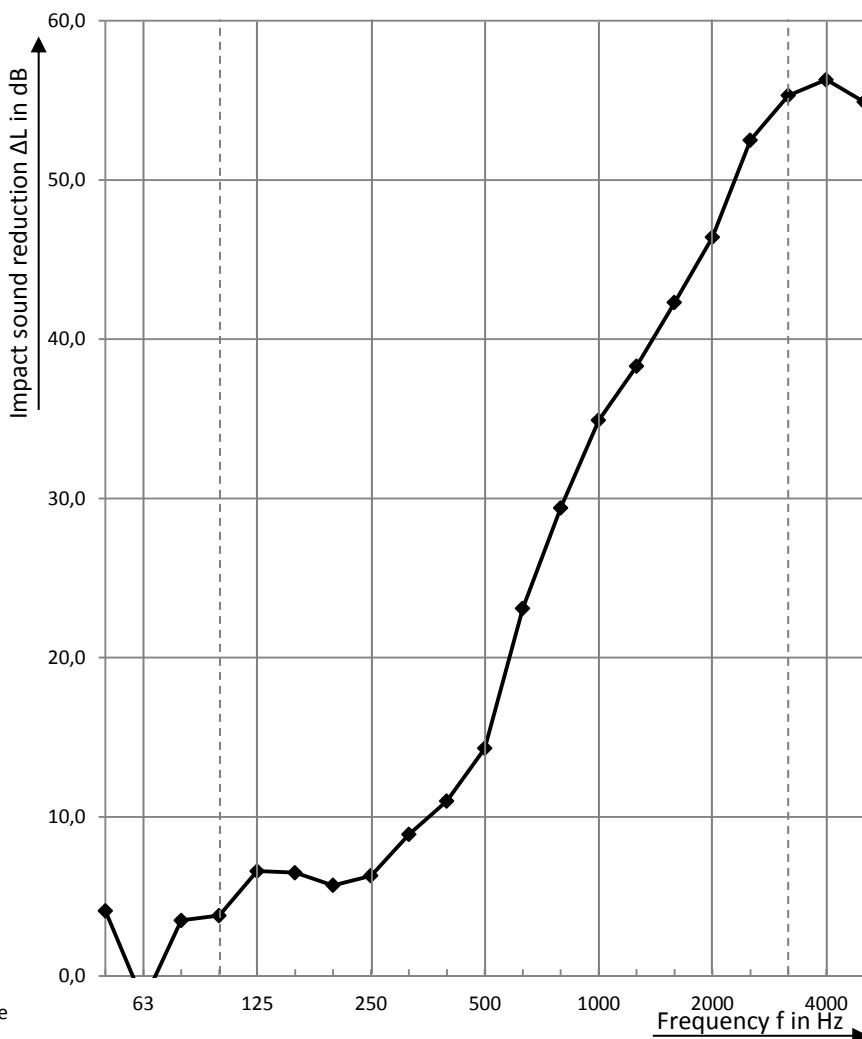

*Airborne noise correction for the measured value

Calculation according to ISO 717-2:2013-06

ΔL_w = 22 dB ΔL_{in} = 12 dB
C_{l,Δ} = -10 dB C_{l,r} = -1 dB C_{l,r,50-2500} = 3 dB

The results are based on tests, which were effected with on artificial source of sound under laboratory conditions. (standard procedure)

Test report no.: 143/162

SWA Schall- und Wärmemesstelle Aachen GmbH

Aachen, 26.05.2014

(Dr.-Ing. A. Siebel)